




MASON-LITE INDOOR FIRE PLACE

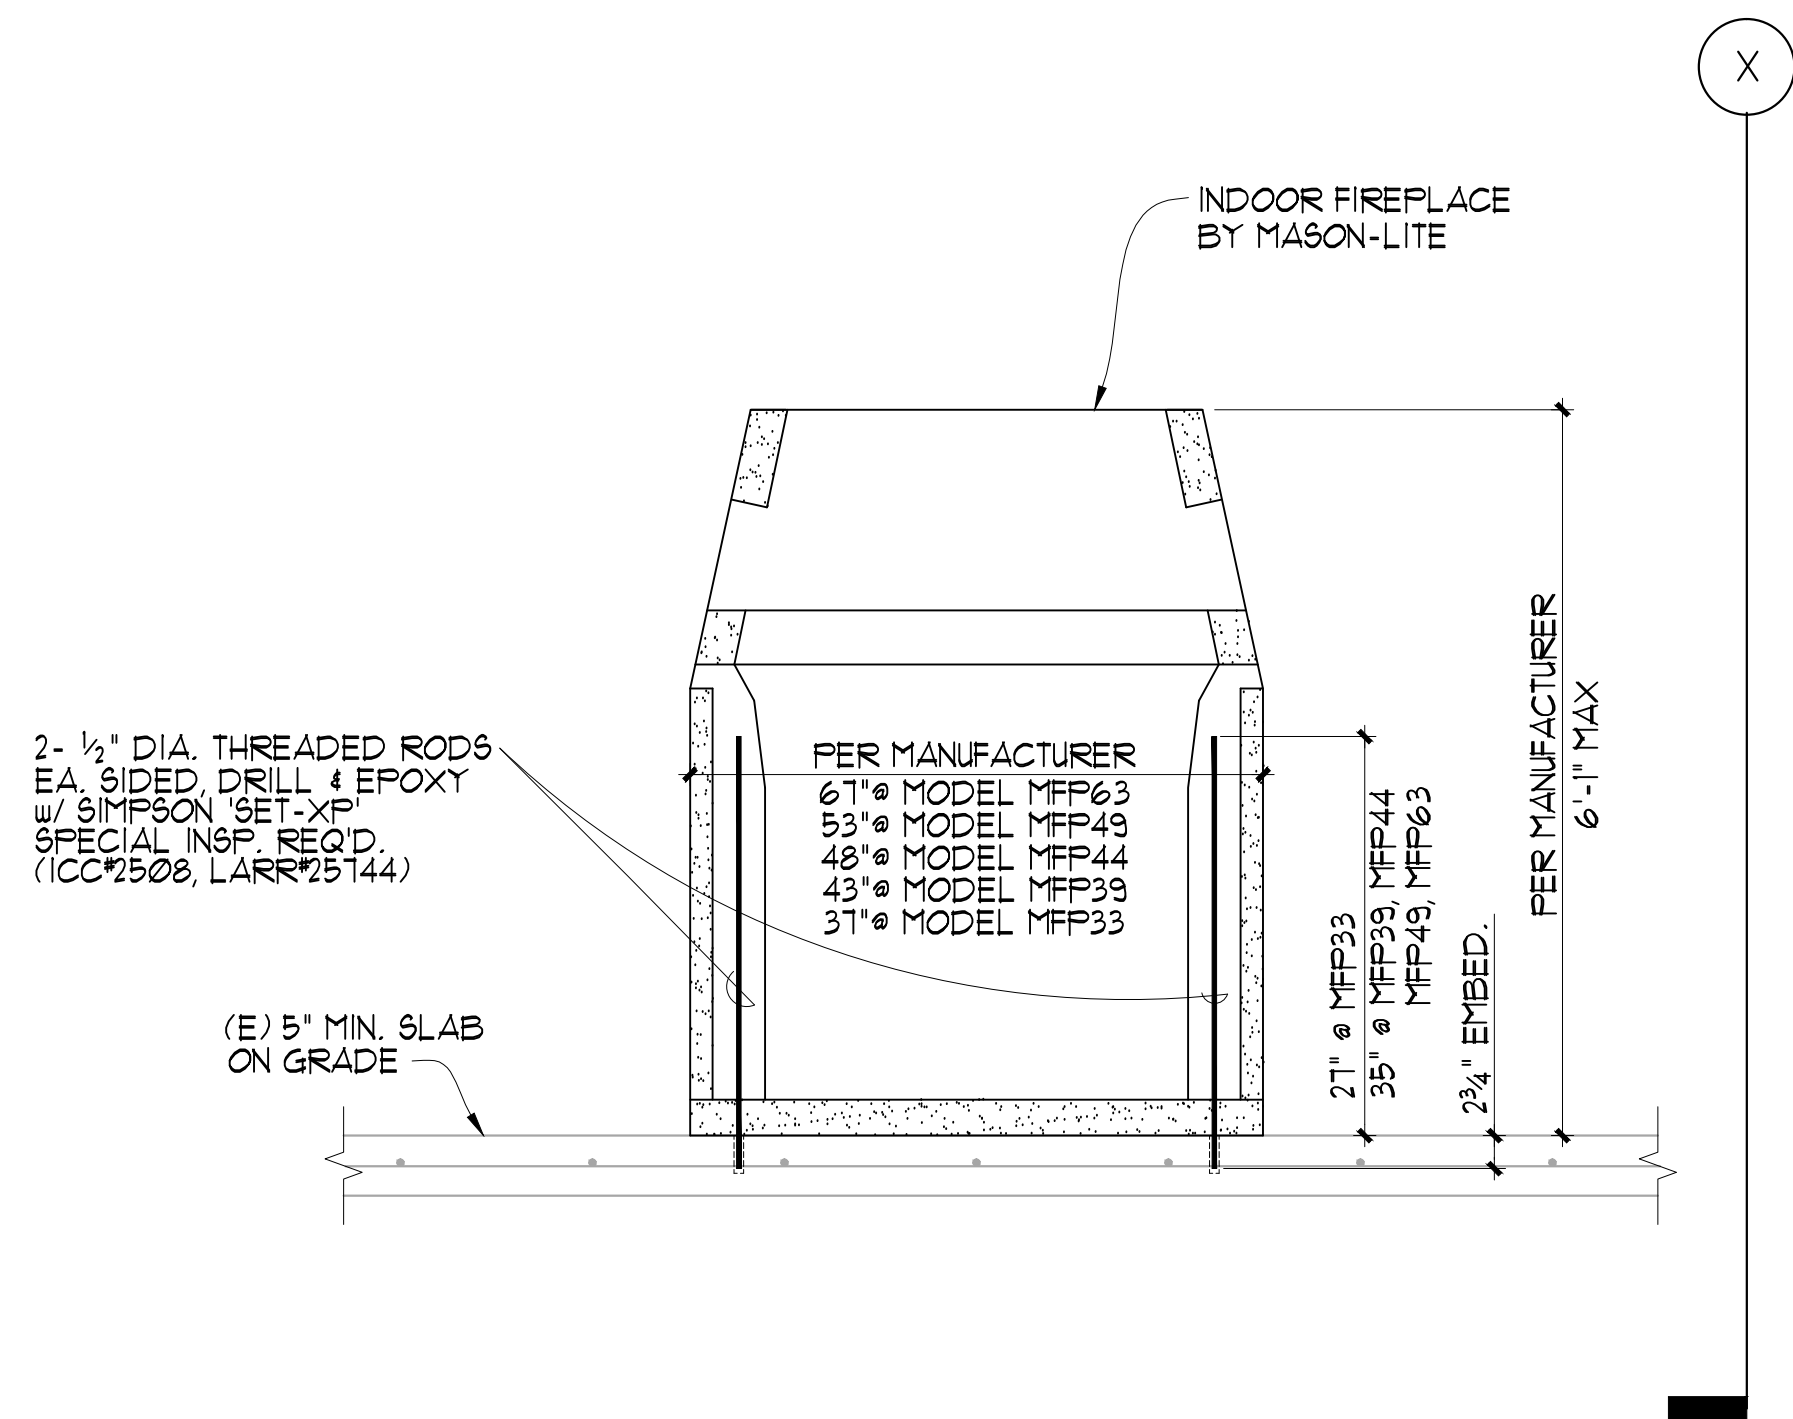

FRONT VIEW ELEVATION (FIG. 1)

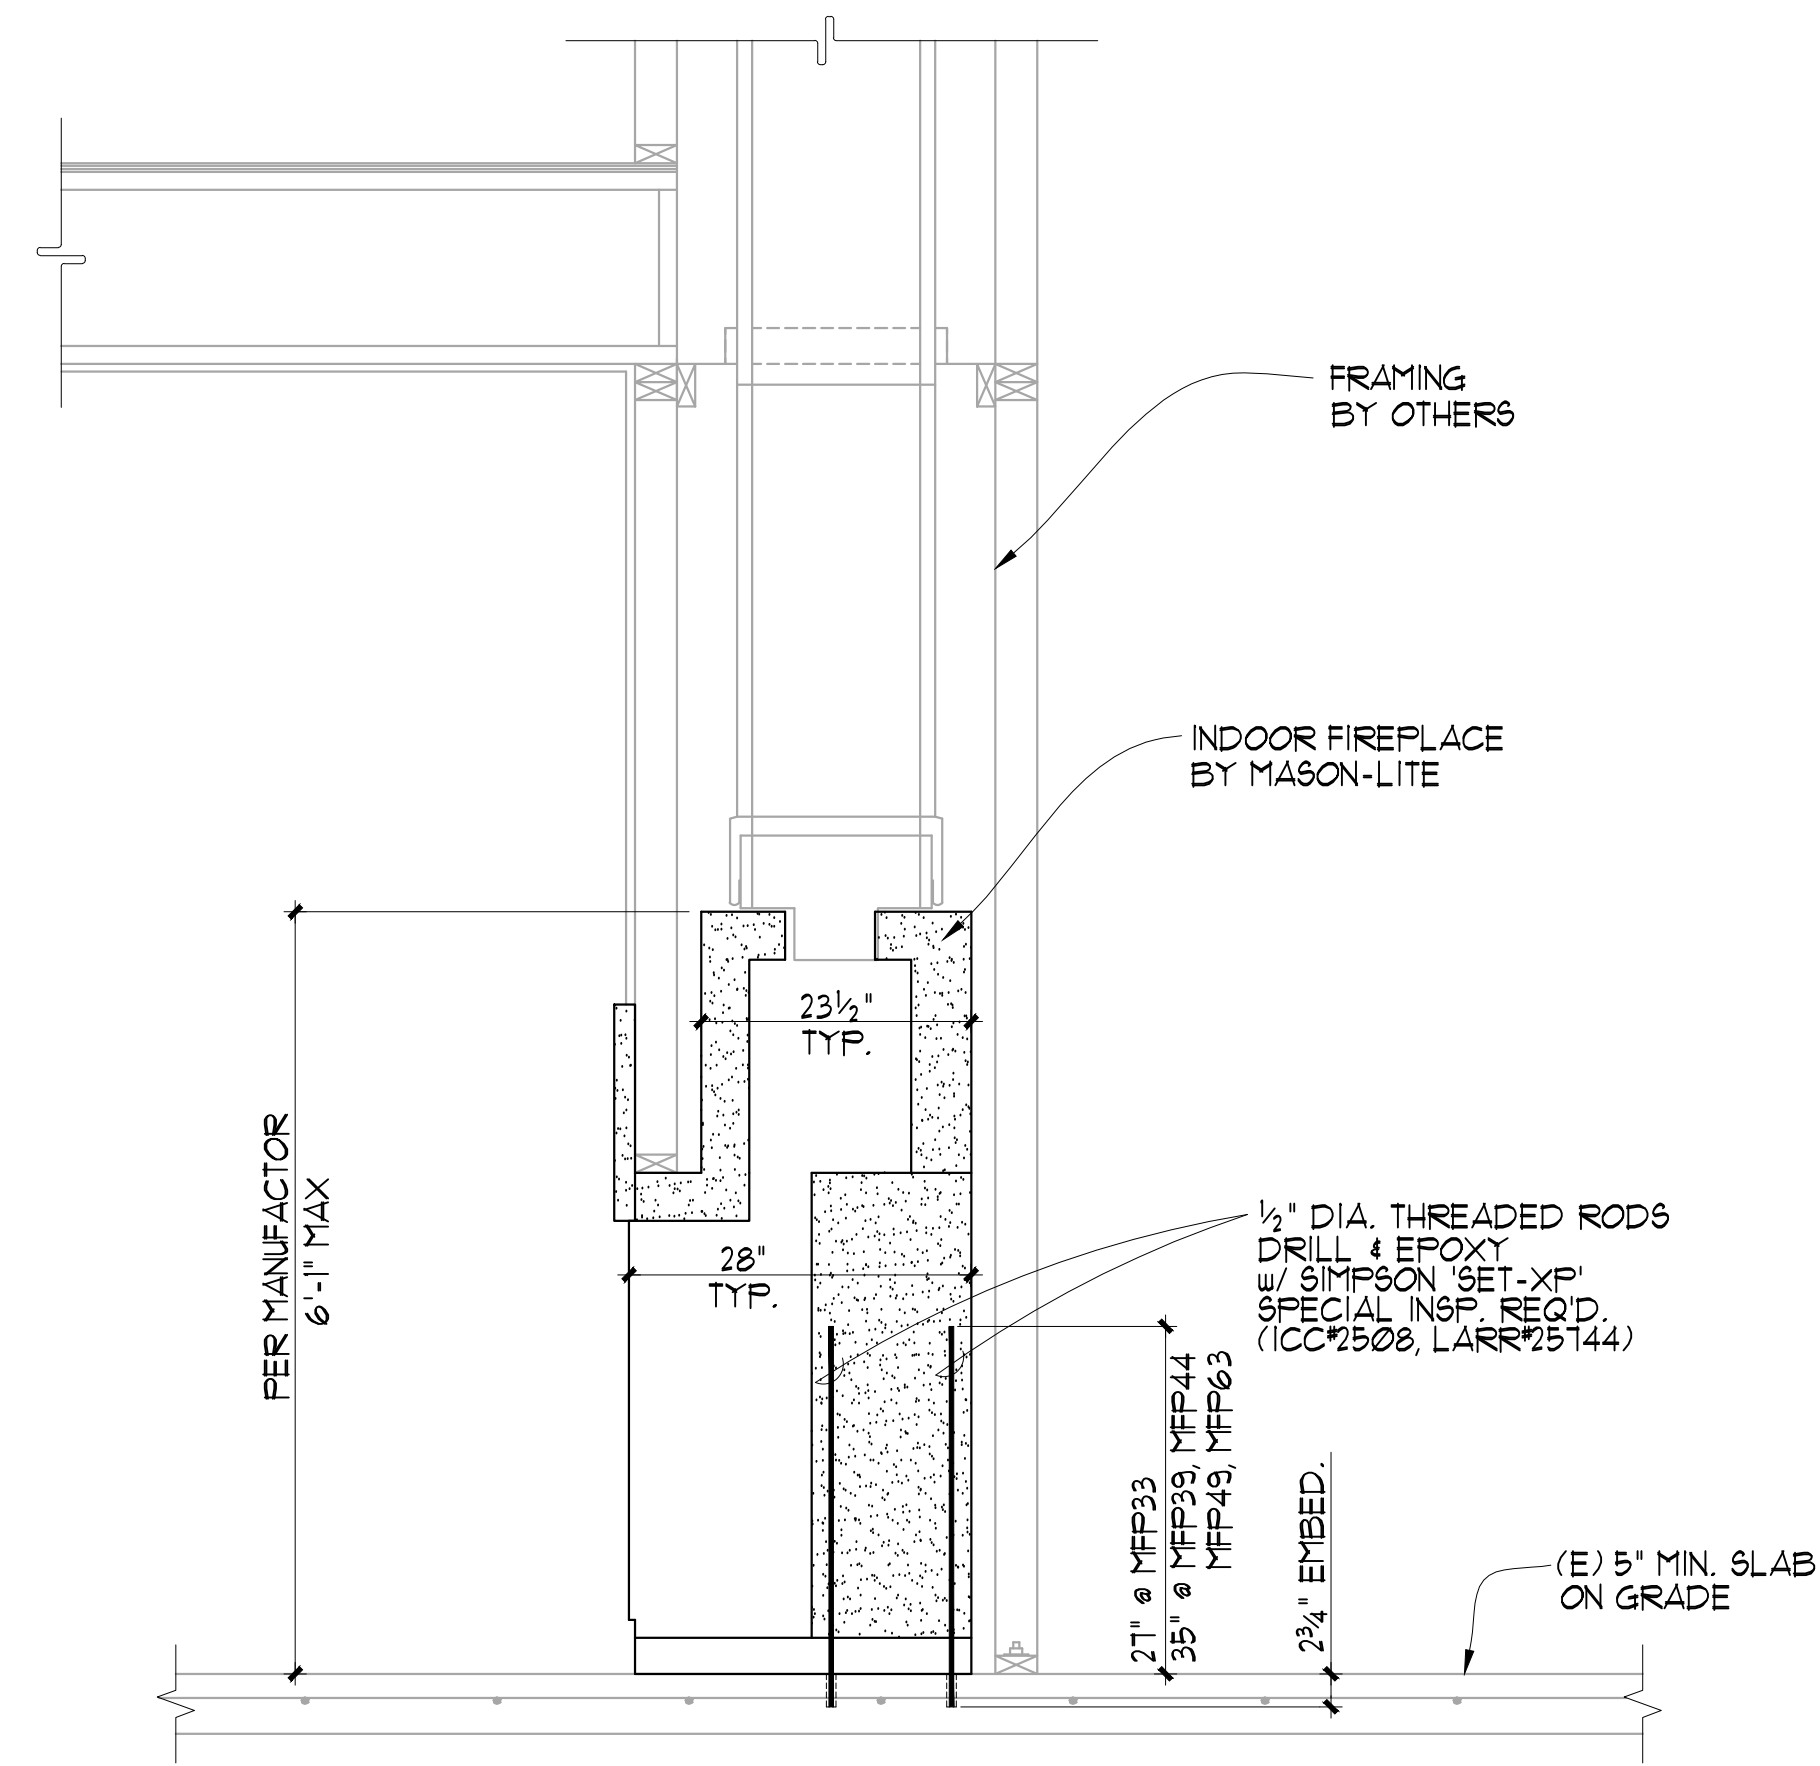

SIDE VIEW ELEVATION (FIG. 2)

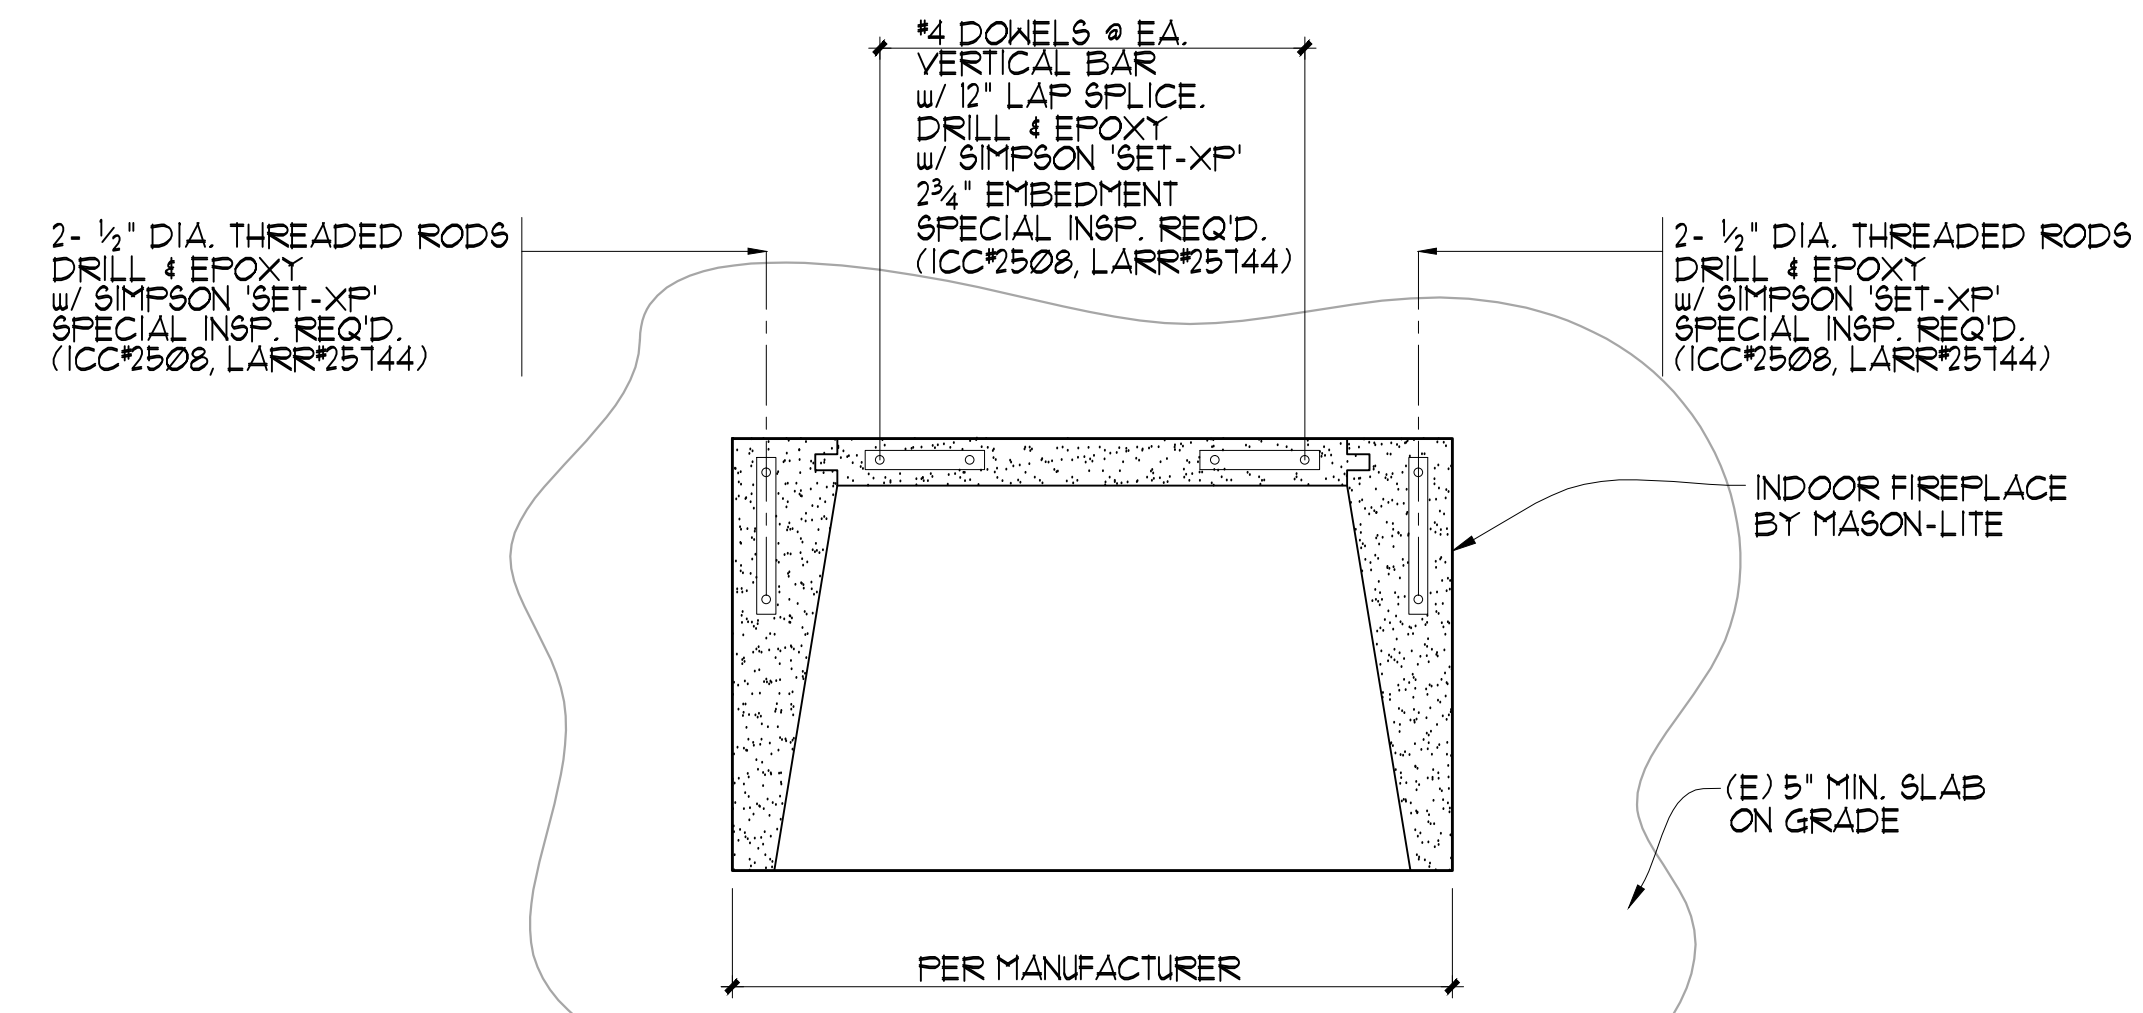

PLAN VIEW (FIG. 3)

FOR ITEMS NOT NOTED
 SEE ELEVATIONS

STRUCTURAL NOTES

- 1.) SOIL SUPPORTING FOOTINGS IS NATIVE SOIL.
- 2.) SOIL ALLOWABLE BEARING PRESSURE USED IN DESIGN IS 1500 PSF.
- 3.) REINFORCING STEEL SHALL CONFORM TO ASTM 615, GRADE 60.
- 4.) THREADED RODS SHALL CONFORM TO ASTM F 1554, GRADE 36.
- 5.) ALL MATERIALS AND WORKMANSHIP SHALL CONFORM TO THE REQUIREMENTS OF THE 2009 INTERNATIONAL BUILDING CODE & LOCAL CITY OR COUNTY REQUIREMENTS.

SPECIAL INSPECTION


1. SPECIAL INSPECTION SHALL MEET THE REQUIREMENTS OF THE 2009 IBC.
2. SPECIAL INSPECTORS SHALL:
 - A) BE UNDER THE SUPERVISION OF A REGISTERED DESIGN PROFESSIONAL.
 - B) OBSERVE THE WORK ASSIGNED FOR CONFORMANCE WITH THE APPROVED DRAWINGS AND SPECIFICATIONS.
 - C) FURNISH INSPECTION REPORTS TO THE ENGINEER AND BUILDING DEPARTMENT. DISCREPANCIES SHALL BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE CONTRACTOR FOR CORRECTION; THEN IF NOT CORRECTED, TO THE ENGINEER AND BUILDING DEPARTMENT.
 - D) SUBMIT TO THE ENGINEER AND BUILDING DEPARTMENT A FINAL REPORT, SIGNED BY A REGISTERED DESIGN PROFESSIONAL, STATING THAT THE WORK WAS IN CONFORMANCE WITH THE APPROVED DRAWINGS AND SPECIFICATIONS AND THE APPLICABLE WORKMANSHIP PROVISIONS OF THE 2009 IBC.
3. INSPECTION NOTES:
 - A) CONSTRUCTION INSPECTIONS LISTED ARE IN ADDITION TO THE CALLED INSPECTIONS REQUIRED BY THE 2009 INTERNATIONAL BUILDING CODE. SPECIAL INSPECTION IS NOT A SUBSTITUTE FOR INSPECTION BY A BUILDING OFFICIAL. SPECIALLY INSPECTED WORK WHICH IS INSTALLED OR COVERED WITHOUT APPROVAL OF THE BUILDING OFFICIAL IS SUBJECT TO REMOVAL OR EXPOSURE.
 - B) CONTINUOUS INSPECTION IS ALWAYS REQUIRED DURING PERFORMANCE OF THE WORK UNLESS SPECIFICALLY NOTED.
 - C) SPECIAL INSPECTORS MUST BE CERTIFIED BY THE BUILDING DEPARTMENT TO PERFORM THE TYPES OF INSPECTIONS SPECIFIED.
 - D) IT IS THE RESPONSIBILITY OF THE OWNER TO INFORM THE SPECIAL INSPECTOR OR INSPECTION AGENCY AT LEAST ONE WORKING DAY BEFORE PERFORMING ANY WORK THAT REQUIRES SPECIAL INSPECTION. ALL WORK PERFORMED WITHOUT REQUIRED SPECIAL INSPECTION IS SUBJECT TO REMOVAL.

SPECIAL INSPECTION REQUIRED

I. ANCHORS, ANCHOR BOLTS, & DOWELS


1. VERIFY MANUFACTURERS INSTALLATION REQUIREMENTS (AND TESTING) OF EPOXIED DOWELS IN CONCRETE AT (HOLD-DOWNS) (EXISTING FOOTINGS) (CONCRETE REPAIRS).

NOTE: FOLLOW ALL MANUFACTURERS INSTALLATION REQUIREMENTS.

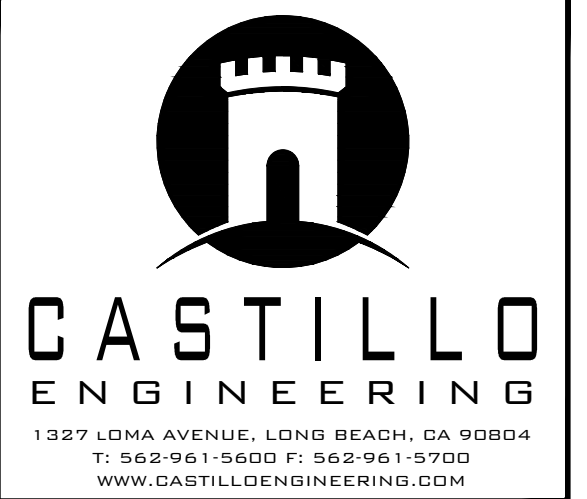

CHECK AND VERIFY ALL DIMENSIONS BEFORE PROCEEDING WITH THE WORK. REPORT DISCREPANCIES TO THE ENGINEER. ALL CONSTRUCTION SHALL CONFORM TO THE C.B.C.

ENGINEER:

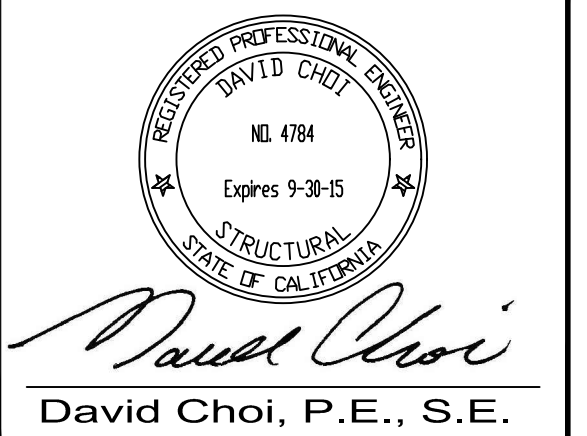

PROJECT:

INDOOR FIREPLACE

MARK	DATE	REVISIONS
1	Nov 15, 2013-1:30pm	
2		
3		

TITLE
 INDOOR FIREPLACE

JOB NO. 12-183	SHEET NUMBER S1 OF 5 SHEETS
DRAWN: FG	
CHECKED: DC	
DATE: 20 DEC 12	